


# GE MS6001FA ( 6F.03) Gas Turbine Generator Set

- 50 Hz Gas Turbine Genset
- Heat rate: 9980 BTU/kWh (lhv)
- 11.5 KV Generator – 92,000 KVA
- Natgas fuel , water inj for NOx
- MK V SpeedTronic Control
- 1999 Simple cycle startup
- 2002 Combined cycle operation
- 2011 Plant Mothballed
- 49,394 lifetime fired hours
- Major overhaul at ~43000 hours  
in 2008 – all new hot section
- Combustion Inspection 2010  
1100 hours since

**For Sale as GT Gen Set only or  
with associated equipment:  
123 MW Combined Cycle  
Power Plant**

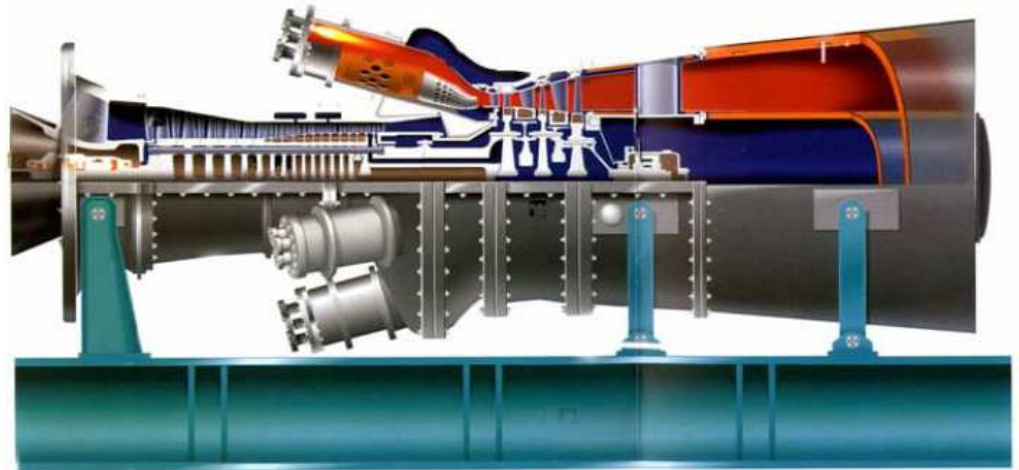

**Contact: Axford Consulting LP (713) 828-3038**  
**[maxford@axfordconsulting.com](mailto:maxford@axfordconsulting.com)**